

## ROME INTERLOCKED ARMOR POWER CABLE, 15000 VOLTS

3 Conductor, Rome-EPR Insulated, 133% Insulation Level, Aluminum or Steel Armor  
Type MV-105 or Type MC, CT Use


**APPLICATION:**

As armored Type MV-105 cable for installation aerially, rack, tray, trough, cable trays, or direct buried; for power circuits not exceeding 15000 volts in manufacturing and processing plants, substations and generating stations. May be used in NEC Class I and II, Div. 2 and Class III, Div. 1 and 2 hazardous locations.

**STANDARDS:**

1. Listed by UL as Type MV-105 per Standard 1072.
2. Also listed for use as Type MC per Standard 1569.
3. Overall jacket UL listed as Sunlight Resistant.
4. Cables pass UL and IEEE-383 ribbon burner flame test and are UL listed For CT Use.
5. Cables pass IEEE-1202/CSA FT4 (70,000 BTU/hr) cable tray flame test.
6. Cables pass ICEA 210,000 BTU/hr Ribbon Burner Flame Test.
7. Cables UL listed for Direct Burial.
8. Conforms to ICEA S-93-639, NEMA WC74 for 5-46 kV Shielded Power Cable.
9. Conforms to ICEA S-97-682 for Utility Shielded Power Cables Rated 5 Through 46 kV.
10. Conforms to AEIC CS8 for Extruded Dielectric, Shielded Power Cables Rated 5 Through 46 kV.

**CONSTRUCTION:** Three conductors of stranded copper, extruded conductor shield, Rome-EPR (ethylene propylene rubber) insulation, extruded thermoset insulation shield, uncoated copper shield tape. Three conductors twisted together with one uncoated copper grounding conductor, suitable fillers, binder tape, aluminum or galvanized steel interlocked armor, red PVC jacket overall.

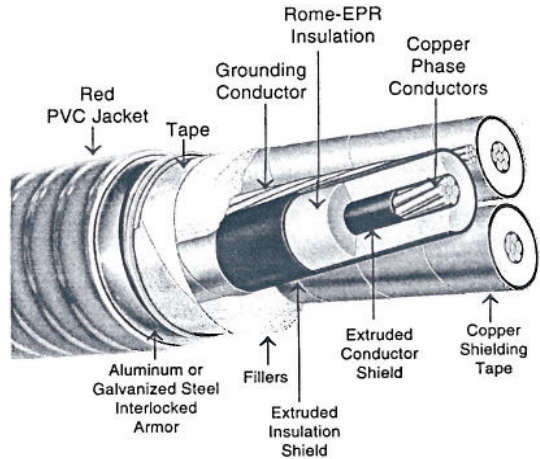

Size AWG or kcmil	No. of Strands	Insul. Thick. Mils	Nom. Diam. Over Ins. Inches	Nom. Diam. Over Armor Inches	PVC Jkt. Thick Mils	Nom. Diam. Over PVC Jkt. Inches	COPPER PHASE CONDUCTORS				
							Copper Grounding Conduc- tor AWG	Approx. Net Wt. lb./1000 Ft.		Ampacity *	Ampacity **
								Alum. Armor	Steel Armor		
<b>15000 VOLTS, 133% INSULATION LEVEL</b>											
2	7	220	.78	2.11	60	2.24	6	2605	3125	165	185
1	19	220	.82	2.20	60	2.33	4	2835	3390	185	210
1/0	19	220	.86	2.28	60	2.41	4	3100	3620	215	240
2/0	19	220	.91	2.39	75	2.55	4	3530	4025	245	275
3/0	19	220	.96	2.50	75	2.66	3	3990	4510	280	315
4/0	19	220	1.02	2.61	75	2.77	3	4615	5200	320	360
250	37	220	1.07	2.79	75	2.95	3	5315	5895	350	400
350	37	220	1.18	3.01	75	3.17	2	6600	7225	430	490
500	37	220	1.30	3.29	85	3.47	1	8710	9350	525	600
750	61	220	1.49	3.67	85	3.85	1/0	11695	12850	635	745

\* **AMPACITY** for cables installed in uncovered cable tray without maintained spacing; 105°C conductor temperature, 40°C ambient.

\*\* **AMPACITY** for cables installed in uncovered cable tray with maintained spacing of one cable diameter; 105°C conductor temperature, 40°C ambient. For other installation conditions refer to the NEC.

NOTE: 1. Phase identification is provided by a longitudinal narrow colored tape (1/3 black, 1/3 red, 1/3 blue) between the semiconducting insulation shield and the copper shielding tape.

Information on this sheet subject to change without notice.

## Specification

### ROME INTERLOCKED ARMOR POWER CABLE, 15000 VOLTS

3 Conductor, Rome-EPR Insulated, 133% Insulation Level,  
Aluminum or Steel Armor

Type MV-105 or Type MC, CT Use

#### 1. SCOPE

1.1 This specification describes three conductor Rome-EPR (ethylene propylene rubber) insulated, aluminum or galvanized steel interlocked armor Type MV-105 power cable for use in 133% insulation level circuits not exceeding 15,000 volts phase to phase at conductor temperatures of 105°C for continuous normal operation, 140°C for emergency overload conditions and 250°C for short circuit conditions. Cables are intended for installation indoors or outdoors, aerially, rack, trough or cable tray, or direct burial.

#### 2. STANDARDS

2.1 The following standards shall form a part of this specification to the extent specified herein:

2.1.1 UL Standard 1072 for Type MV-105 cable.

2.1.2 ICEA Pub. No. S-93-639, NEMA Pub. No. WC74 for 5-46 kV Shielded Power Cable.

2.1.3 ICEA Pub. No. S-97-682 for Utility Shielded Power Cables Rated 5 Through 46 kV.

2.1.4 AEIC CS8 for Extruded Dielectric, Shielded Power Cables Rated 5 Through 46 kV.

#### 3. CONDUCTORS

3.1 Class B stranded annealed uncoated copper per Part 2 of ICEA.

#### 4. CONDUCTOR SHIELD

4.1 Conductors shall be covered with a layer of extruded conducting thermosetting compound with thickness in accordance with Table 3-1 of ICEA S-97-682. The extruded layer shall be compatible with and firmly bonded to the cable insulation and shall be in accordance with Par. 3.1 and meet the resistivity requirements of Par. 3.6.1 of ICEA S-97-682.

#### 5. INSULATION

5.1 Directly over the conductor shield shall be applied a homogenous wall of Rome-EPR insulation. The average thickness of insulation shall be 220 mils. Minimum thickness at any point shall be not less than 90% of the specified thickness. Physical and electrical properties of the insulation shall be in accordance with Part 4 of ICEA S-97-682 for a Class III insulation.

#### 6. SHIELDING

6.1 Over the insulation shall be applied an extruded conducting thermosetting insulation shield. It shall be intimate contact with the outer surface of the insulation and shall be free stripping, leaving no conducting particles or other residue on the insulation surface. This layer shall be legibly identified as being conducting. The average thickness of this layer shall be in accordance with Table 5-1 of ICEA S-97-682. The insulation shield shall meet the requirements of Par. 5.5.1 of ICEA S-97-682.

6.2 An uncoated copper tape shall be helically applied over the extruded insulation shield with a minimum lap of 12.5%. The copper tape shall meet the requirements of Part 6 of ICEA S-97-682.

#### 7. PHASE IDENTIFICATION

7.1 A colored tape shall be applied longitudinally under the copper shielding tape to provide phase identification.

#### 8. ASSEMBLY

8.1 Three phase conductors shall be cabled together with a Class B stranded, uncoated copper grounding conductor and suitable fillers to make round. Length of lay shall not exceed 35 times the phase conductor diameter. The grounding conductor shall comply with the requirements of UL Standard 1072.

#### 9. CABLE TAPE

9.1 A suitable cable tape shall be applied over the assembly to hold the core together and provide bedding for the armor.

#### 10. ARMOR

10.1 An aluminum or galvanized steel interlocked armor shall be applied over the cable core. Armor shall be in accordance with UL Standard 1072 and Par. 7.3.3 of ICEA S-93-639

#### 11. COVERING

11.1 Shall be PVC meeting the requirements of Part 7 of ICEA S-93-639 and UL 1072. The covering shall meet the Sunlight Resistant requirements of UL. Average thickness shall be in accordance with UL 1072. Minimum thickness at any point shall be not less than 70% of the required average thickness.

#### 12. IDENTIFICATION

12.1 An ink print legend shall be applied to the surface of the PVC covering providing cable and manufacturer identification.

#### 13. TESTS

13.1 Cables shall be tested in accordance with ICEA S-93-639, ICEA S-97-682, AEIC CS8 and UL Standard 1072.

13.2 Cables shall be capable of passing the ribbon burner cable tray flame test requirements of UL and shall be UL listed "For CT Use". Cables shall also be capable of complying with the IEEE-1202/CSA FT4 flame test.